

## CFR

# INSULATED METAL ROOF PANEL

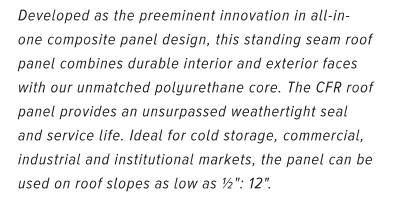

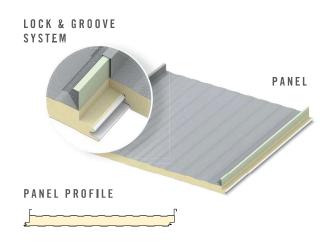

#### PRODUCT SPECIFICATIONS

WIDTH 30", 36", 42"

THICKNESS 2", 2 1/2", 3", 4", 5", 6"

**LENGTH** 9'-6" to 53'-0"; contact your sales representative

for custom length availability

 $\textbf{EXTERIOR} \ \ \textbf{FACE} \ \ \textbf{Stucco-embossed}, \ \textbf{G-90} \ \ \textbf{galvanized} \ \ \textbf{and/or} \ \ \textbf{AZ-50}$ 

aluminum-zinc coated steel in 24 and 22 Ga.; or AZ-55 aluminum-zinc coated steel with a clear acrylic

coating in 24 Ga.

INTERIOR FACE Stucco-embossed, G-90 galvanized and/or AZ-50

aluminum-zinc coated steel in 26, 24 and 22 Ga.

JOINT Mechanically seamed singlelock standing seam at the exterior side joint. The interior side joint is a single tongue-and-groove interlock.

**EXTERIOR PROFILE** 2" high standing seam with a Mesa profile between the seams

INTERIOR PROFILE Mesa profile, nominal 1/8" deep

UPLIFT PERFORMANCE: UL 90 rated, FM Approvals Standard 4471,

and Florida Building Code approved. Dade County NOA.

#### U-FACTORS AND R-VALUES\*

U-FACTOR (BTU/h·ft²·°F) PANEL WIDTH: 42"		R-VALUE (h·ft²·°F/BTU) PANEL WIDTH: 42"	
	75°		75°
2"	0.0600	2"	16.67
21/2"	0.0490	21/2"	20.41
3"	0.0414	3"	24.15
4"	0.0318	4"	31.45
5"	0.0257	5"	38.91
6"	0.0217	6"	46.08

\*Based on ASTM C518, ASTM C1363 and thermal modeling,  $75^{\circ}$  F core mean temp.

#### DESIGN FEATURES & BENEFITS

- Weathertight vertical side seaming and installation savings with fewer side joints to seal
- Factory-cut panel ends, factory notching and factory-swaged ends eliminate field work and erection costs
- Factory-installed backer plates at the endlaps eliminate pre-drilling for special fasteners
- Installed from the top side to provide concealed clips and fasteners

### **TESTING: CFR INSULATED METAL ROOF PANEL**

TEST/APPROVAL	TEST METHOD	TEST TITLE	RESULTS
Fire US	ASTM E84	Surface Burning Characteristics of Building Materials	Flame spread <25, smoke developed <450
	ASTM E108	Standard Test Methods for Fire Tests of Roof Coverings	Passed Class A
	FM 4880	Class 1 Fire Rating of Insulated Wall, Ceiling and Roof Panels	Product approved  Exterior roof requires FM 4471 approval
	NFPA 286	Fire Tests for Evaluating Contribution of Wall and Ceiling Finish to Roof Fire Growth	Test specimen met the criteria of the IBC Section 803.1.2.1
Fire Canada	CAN/ULC S102	Surface Burning Characteristics of Building Materials and Assemblies	Meets the National Building Code of Canada requirements
	CAN/ULC S107	Methods of Fire Tests of Roof Coverings	Passed Class A
	CAN/ULC S126	Fire Spread Under Roof-Deck Assemblies	Met the criteria of the standard
Structural	ASTM E72	Strength Tests of Panels for Building Construction	See Load Chart
	ASTM E1592	Structural Performance of Metal Roof and Siding Systems by Uniform Static Air Pressure Differences	See Load Chart
	FM 4471	Class 1 Exterior Roof Structural Performance	See FM Roof Load Chart
	UL 580	Uplift Resistance of Roof Assemblies	UL Class 90 Uplift at 5' and 7'
	UL 1897	Uplift Tests for Roof Covering Systems	Uplift Resistance of 166 psf at 5' Uplift Resistance of 140 psf at 7'
Thermal Performance	ASTM C518	Steady-State Thermal Transmission Properties by Means of the Heat-Flow Meter Apparatus	K-Factor of 0.126 BTU.in/hr.ft².°F at 40° F mean core K-Factor of 0.14 BTU.in/hr.ft².°F at 75° F mean core
	ASTM C1363	Thermal Performance of Building Materials and Envelope Assemblies	See Thermal Performance Guide
Air Infiltration	ASTM E1680	Rate of Air Leakage Through Exterior Metal Roof Panel Systems	<0.023 cfm/ft² at 12 psf
Water Infiltration	ASTM E1646	Water Penetration of Exterior Metal Roof Panel Systems by Static Air Pressure	No uncontrolled leakage when tested to a static pressure of 12 psf
		Differences	Vertical or horizontal installation
Special Approval	Miami-Dade NOA	Product Approval for City of Miami and Dade County	Product has City of Miami and Dade County Notice of Acceptance
	State of Florida	Product Approval for the State of Florida	Product has State of Florida approval

Descriptions and specifications contained herein were in effect at the time this publication was approved for printing. Application details are for illustration purposes only and may not be appropriate for all environmental conditions, building designs or panel profiles. Projects should be designed to conform to applicable building codes, regulations and accepted industry practices. If there is a conflict between this document and project erection drawings, the erection drawings will take precedence.